


PAPRA KUND (PPKD) E.I. MACLS, 'B' CLASS STD-(II)R

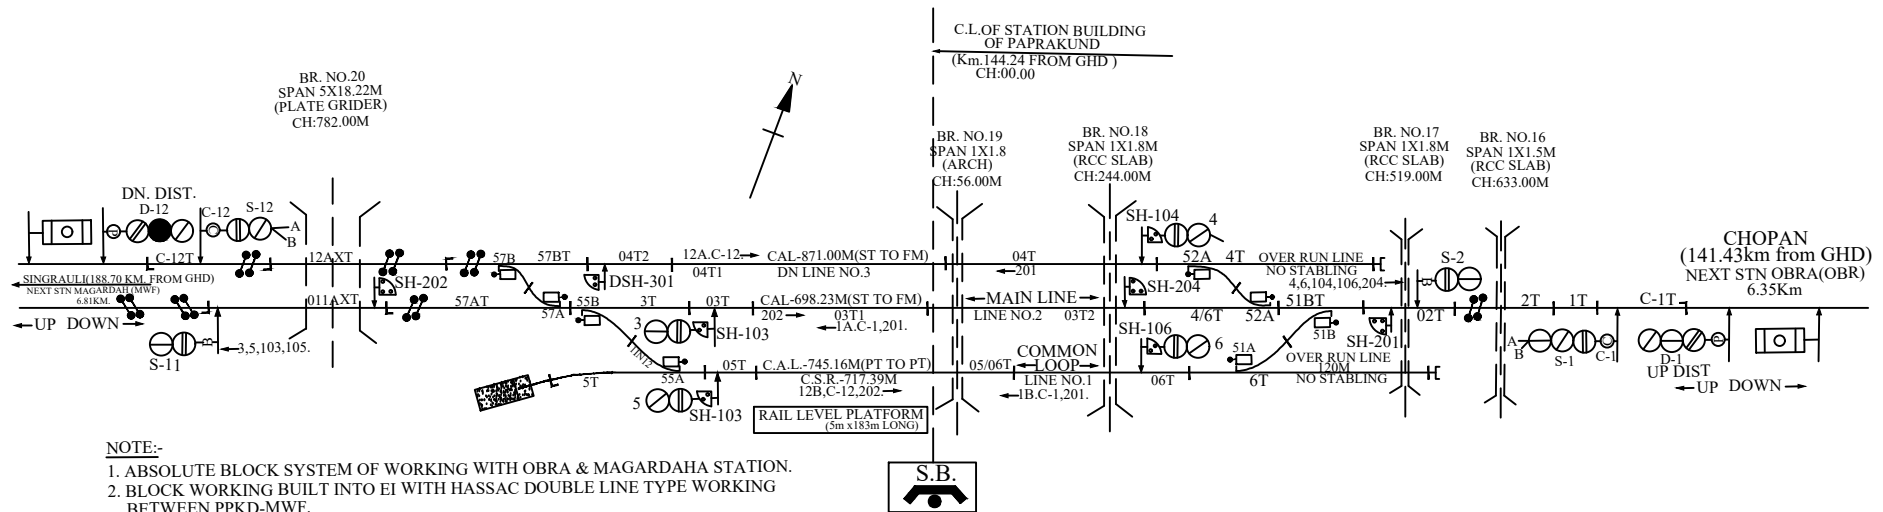

NOTE:-

1. ABSOLUTE BLOCK SYSTEM OF WORKING WITH OBRA & MAGARDAHA STATION.
2. BLOCK WORKING BUILT INTO EI WITH HASSAC DOUBLE LINE TYPE WORKING BETWEEN PPKD-MWF.
3. ALL ANGLE OF X-ING ARE 1 IN 12 EXCEPT AS MENTIONED.
4. CONTROL TELEPHONE PROVIDED AT SM PANEL .
5. LED SIGNAL PROVIDED FOR ALL SIGNALS.
6. THIS SWRD HAS BEEN MADE IN CONNECTION WITH RAMNA-SINGRAULI DOUBLING PROJECT.
7. THIS SIP SUIT 25KV AC TRACTION AREA.
8. 60 SEC TIME DELAY PROVIDED FOR ALL CALLING ON RECEPTION SIGNALS.
9. TWO VDU(ONE STAND BY) PROVIDED FOR PANEL OPERATION IN LIEU OF CONTROLLED CUM INDICATION PANEL.
10. SINGLE LINE TOKENLESS BLOCK INSTRUMENT WITH OBRA LOCATED AT PANEL ROOM (FM DAIDO TYPE).
11. 52 BT IS FAULING T.C. FOR RECEPTION AND DESPATCH FOR LINE NO.1.